
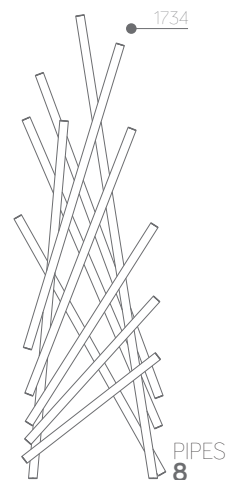


Shanghai

Technical sheet

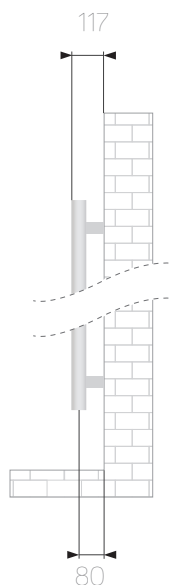

Material	Carbon steel
Pipes- Ø	32x1,5
Collectors - Ø	32x1,5
Connections	3x1/2 (air bleeding valve connection, included)
Wall fixings	3
Max pressure	10 bar
Max temperature	90 °C
Paint	epoxypolyester powder
Packaging	cardboard box + styrofoam protections + polyethylene foam sheet

Standard equipment: 1 kit wall fixing brackets - 1 air bleeding valve - 1 chromed cap for air bleeding valve

White VOV09

code	h (mm)	width (mm)	interaxis (mm)	weight (kg)	water (lt)	ΔT50 °C watt	ΔT30 °C watt	ΔT42,5 °C watt	ΔT60 °C watt	Exponent n
380228	1734	567	450	13,7	6,3	552	295	453	691	1,22881

Anthracite VOV12

code	h (mm)	width (mm)	interaxis (mm)	weight (kg)	water (lt)	ΔT50 °C watt	ΔT30 °C watt	ΔT42,5 °C watt	ΔT60 °C watt	Exponent n
380227	1734	567	450	13,7	6,3	552	295	453	691	1,22881

Our radiators are tested in qualified laboratories according to EN-442 regulations which determine the output value by fixing the ΔT at 50 °C. ΔT is the difference between the average temperature of the water inside the radiator and the room temperature. The formula is: $((T_1+T_2)/2)-T_3$.

Ex: $((75+65)/2)-20=50$ °C. For output values with a different ΔT use the following formula: $\phi_x = \phi_{\Delta T50} * (\Delta T_x/50)^n$.

See calculation example of the output at ΔT 60 °C of article 380228: $552 * (60/50)^{1,22881} = 691$.

Output values in kcal/h = watt x 0,85984. Output values in btu = watt x 3,412.

KEY

T₁ = supply temperature - T₂ = return temperature - T₃ = room temperature.

φ_x = output to be calculated - φ_{ΔT50} = output at ΔT 50 °C (table) - ΔT_x = ΔT value to be calculated - n = exponent "n" (table).