

Destinatar

Expeditor

Firma
Referinta
Adresa
Phone
Fax
E-mail

Cod articol :

0090114

Articol:

MICRA 50 M

Date pompa

Presiune nominala:

Temperatura min. fluid 0 °C

Temperatura max. fluid 35 °C

Max. Permitted amount of sand : 40 g/m³

Date de functionare cerute

Debit :

Înaltime de pompare :

Fluid pompat : Apă

Temperatura fluid: 20 °C

Densitate 998.3 kg/m³

Vasozitate cinematica: 1.005 mm²/s

Presiune de vapori: 2.34 kPa

Date disponibile:

Debit :

Înaltime de pompare :

Materiale

Suport de baza Brass OT58

Rotor Noryl GFN2

Difuzor Polyacetel



Piulita de blocare rotor AISI 304

Canal de cablu AISI 430

Arbore cu cuplaj AISI 430F

Filtru AISI 430

Curve tolerance according to ISO 9906

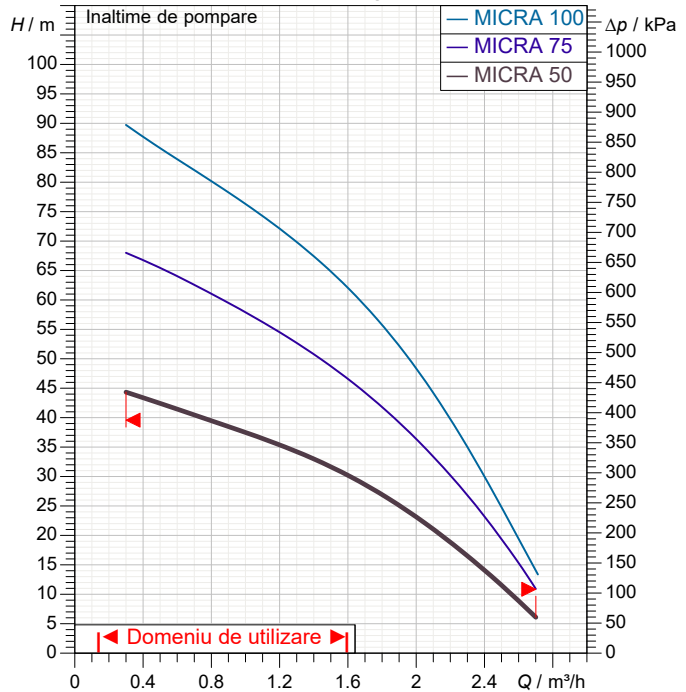

Date motor

Marca :

TESLA

Putere nominala P2:

0.37 kW

Tensiune nominala :

1~ 230 V 50 Hz

Curent nominal :

3.3 A

Number of poles :

2

Viteza nominala:

2800 1/min

Grad de protecție:

IP 68

Masa

9 kg

Dimensiuni de gabarit mm

| | | | | | |
|-----|-----|--|--|--|--|
| DNM | 1" | | | | |
| H | 930 | | | | |
| Ø | 74 | | | | |

Racorduri pompa:

Partea cu aspiratia: /

Partea cu refularea: 1" G / --



CURBELOR CARACTERISTICE

12/21/2021

Pagina 2 / 3

DAB PUMPS S.p.A.
Via Marco Polo, 14 - 35035 Mestrino (PD), Italy
Tel. +39 049 5125000 - Fax +39 049 5125950
www.dabpumps.com


Destinatar

Expeditor

Firma
Referinta
Adresa
Phone
Fax
E-mail

MICRA 50 M

Curve tolerance according to ISO 9906

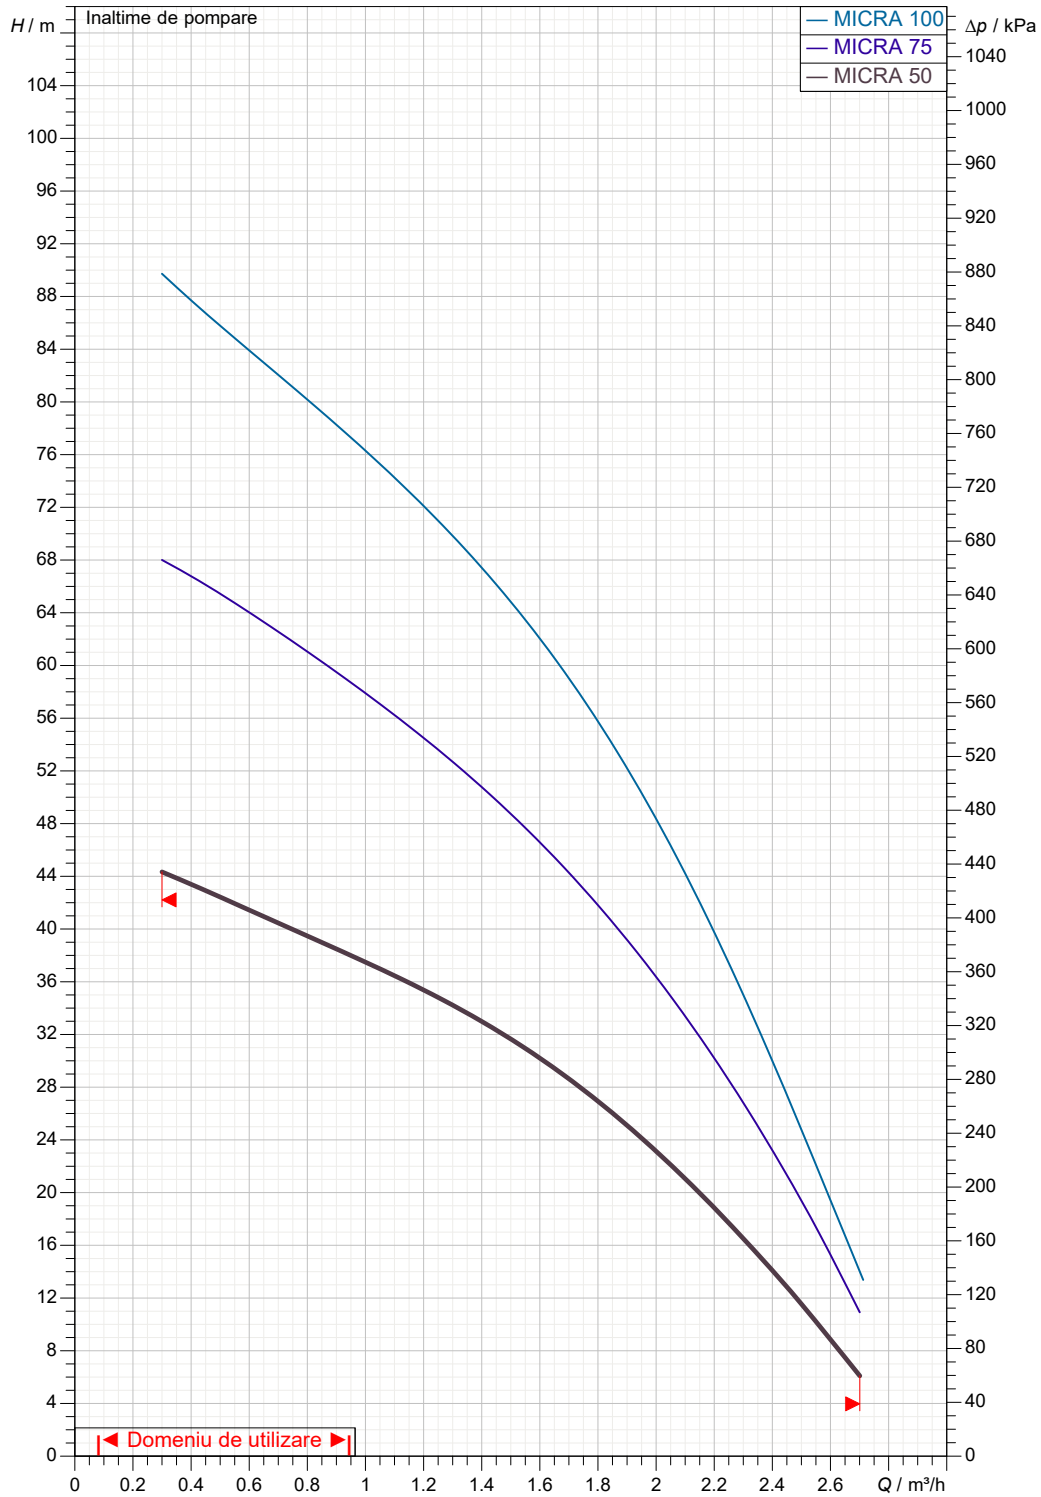

Date disponibile:

Partea cu aspiratia:

Partea cu refularea:

Debit :

Înaltime de pompare :

Viteza nominala:

1" G
--

2800 1/min

MAIN_PROJECT_TITLE

BUSINESS_PROCESS_IT

OWNER_

ISSUE_DATE



DESEN DIMENSIONAL

12/21/2021

Pagina 3 / 3


DAB PUMPS S.p.A.
Via Marco Polo, 14 - 35035 Mestrino (PD), Italy
Tel. +39 049 5125000 - Fax +39 049 5125950
www.dabpumps.com

Destinatar

Expeditor

Firma
Referinta
Adresa
Phone
Fax
E-mail

MICRA 50 M

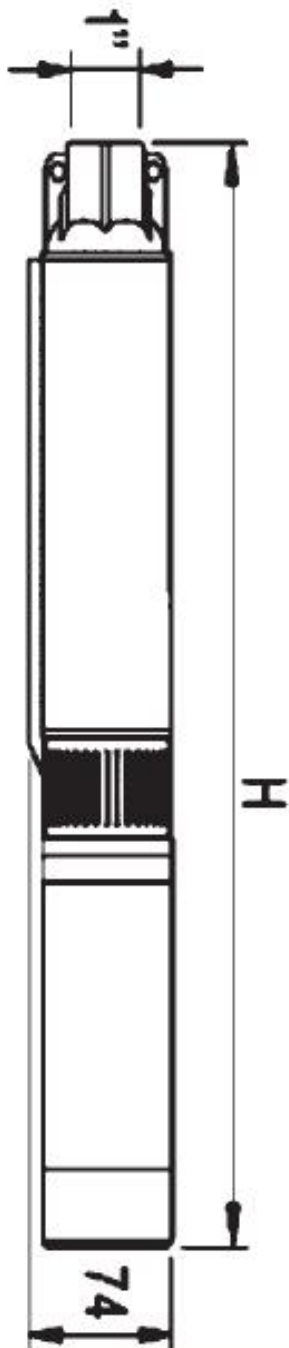

Dimensiuni in mm

Racorduri pompa:

| | | | | | | | |
|----|-----|-----|--|--|--|--|-----------|
| 1 | DNM | 1" | | | | | |
| 2 | H | 930 | | | | | Aspiratie |
| 3 | Ø | 74 | | | | | |
| 4 | | | | | | | |
| 5 | | | | | | | |
| 6 | | | | | | | |
| 7 | | | | | | | Refulare |
| 8 | | | | | | | 1" G |
| 9 | | | | | | | -- |
| 10 | | | | | | | |
| 11 | | | | | | | |
| 12 | | | | | | | |

MAIN_PROJECT_TITLE

BUSINESS_PROCESS_ID

OWNER

ISSUE_DATE