

## Destinatar

Firma  
Referinta  
Adresa  
Phone  
Fax  
E-mail

### Cod articol :

60219347H

### Customer pos. no.:

### Articol:

FEKA VS 550 M - A

### Date pompa

Free passage : 50 mm

Presiune nominala:

Temperatura min. fluid 0

Temperatura max. fluid 50 °C

Temperatura max. ambianta 40 °C

### Date de functionare cerute

Debit :

Inaltime de pompare :

Fluid pompat : Apă

Temperatura fluid: 20 °C

Densitate 998.3 kg/m³

Vascozitate cinematica: 1.005 mm²/s

Presiune de vapori: 2.34 kPa

### Date disponibile:

Debit :

Inaltime de pompare :

### Materiale

Corp pompa Otel inox AISI 304

Rotor Otel inox AISI 304

Carcasa motorului Otel inox AISI 304



Etansare mec. completa pe partea pompei Silicon carbide/Silicon carbide

Etansare mec. completa pe partea motorului Carbon/Alumina

Motor shaft pump side Otel inox AISI 316

Motor shaft motor side Steel C10

### Curve tolerance according to ISO 9906

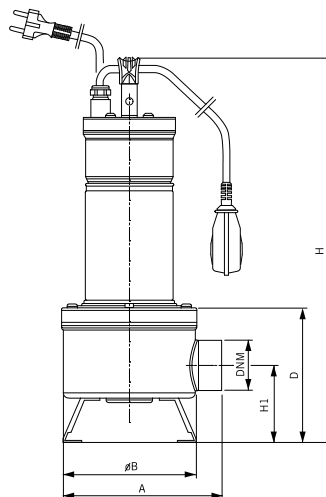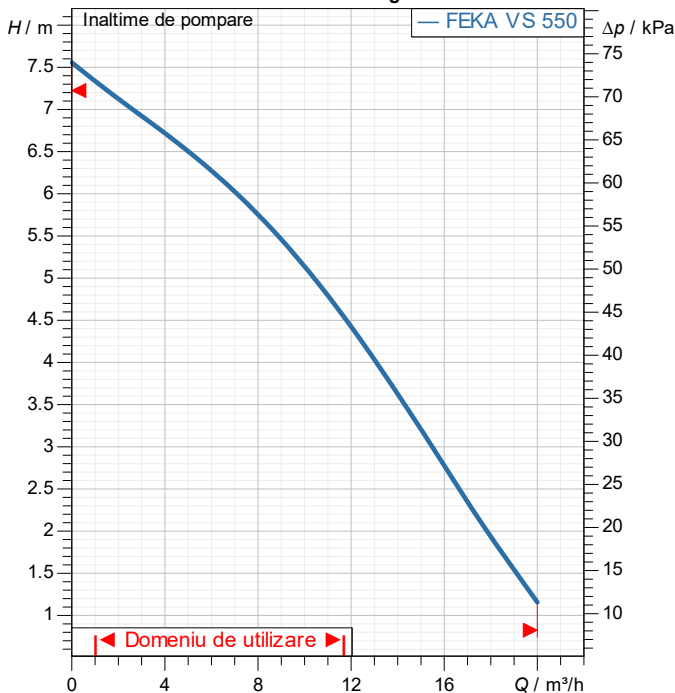

### Date motor

Marca :

DAB

Max Power input P1 :

0.9 kW

Putere nominala P2:

0.55 kW

Viteza nominala:

2800 1/min

Tensiune nominala :

1~ 220-240 V

50 Hz

Curent nominal :

4.1 A

Grad de protecție:

IP 68

### Masa

12.5 kg

### Dimensiuni de gabarit mm

|     |      |  |  |  |  |
|-----|------|--|--|--|--|
| A   | 203  |  |  |  |  |
| B   | 170  |  |  |  |  |
| D   | 172  |  |  |  |  |
| DNM | 2" F |  |  |  |  |
| H   | 475  |  |  |  |  |
| H1  | 98   |  |  |  |  |

### Racorduri pompa:


Partea cu aspiratia: /  
Partea cu refularea: 2" GAS / --

Destinatar

Firma  
Referinta  
Adresa  
Phone  
Fax  
E-mail

## FEKA VS 550 M - A

Curve tolerance according to ISO 9906

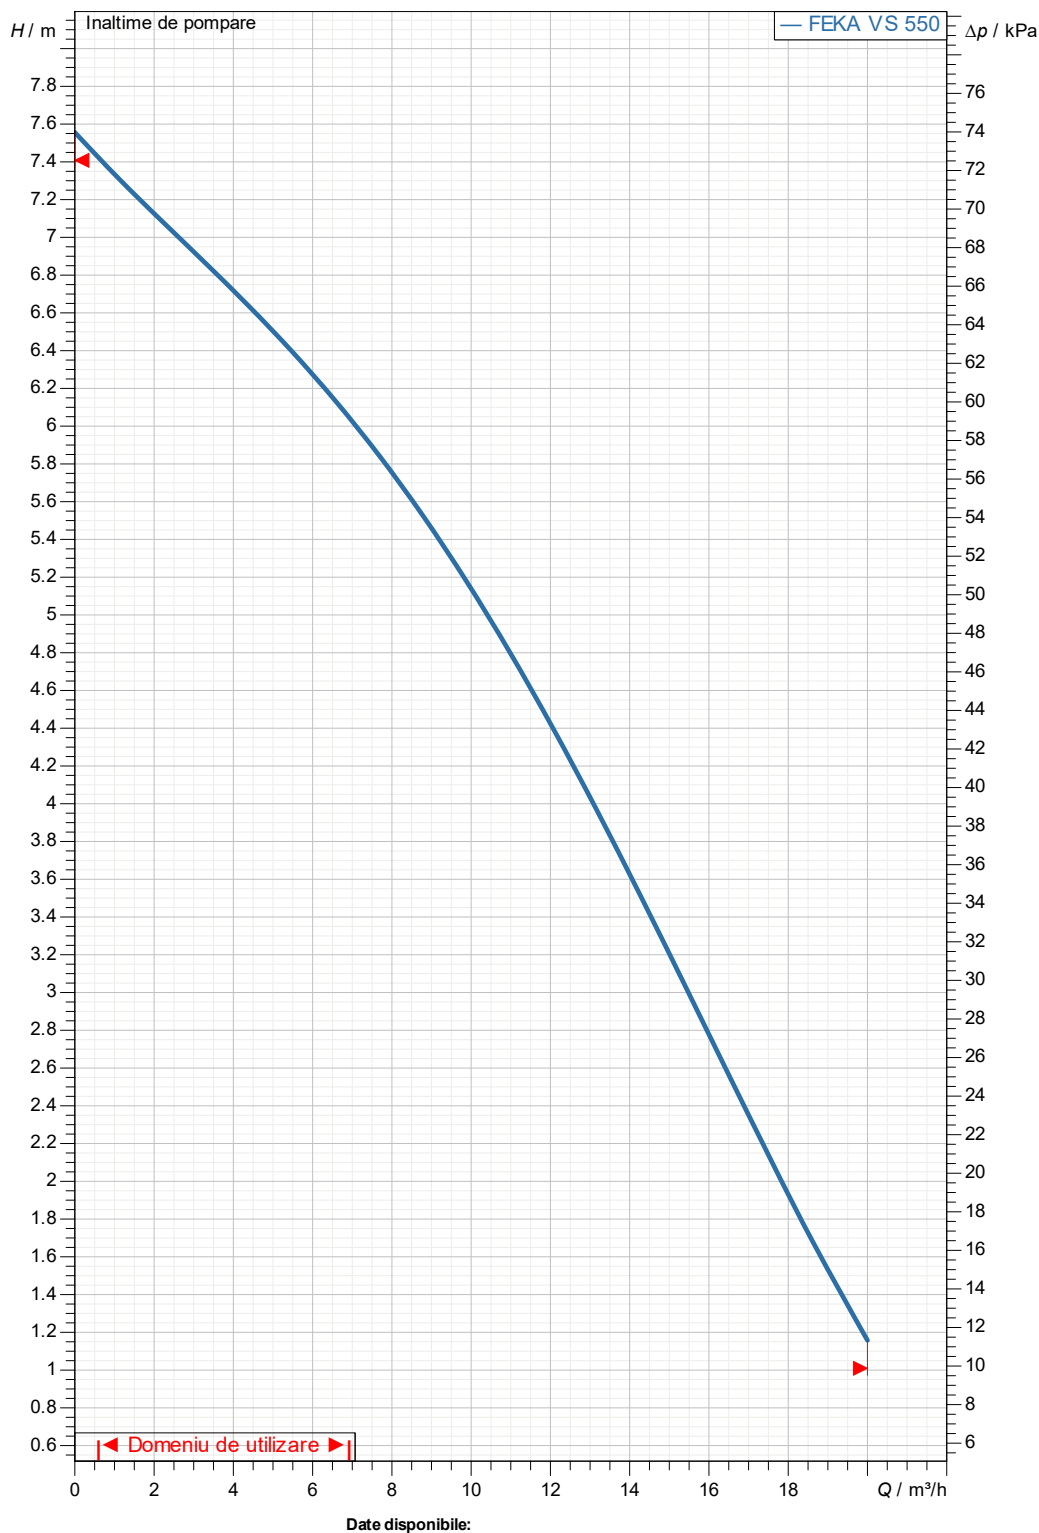

Date disponibile:

Partea cu aspiratia:

Partea cu refularea:  
2" GAS  
--

Debit :

Înaltime de pompare :

Viteza nominala:  
2800 1/min

MAIN\_PROJECT\_TITLE

BUSINESS\_PROCESS\_ID

OWNER\_


ISSUE\_DATE

05/07/2026

Destinatar

Firma  
Referinta  
Adresa  
Phone  
Fax  
E-mail

## FEKA VS 550 M - A

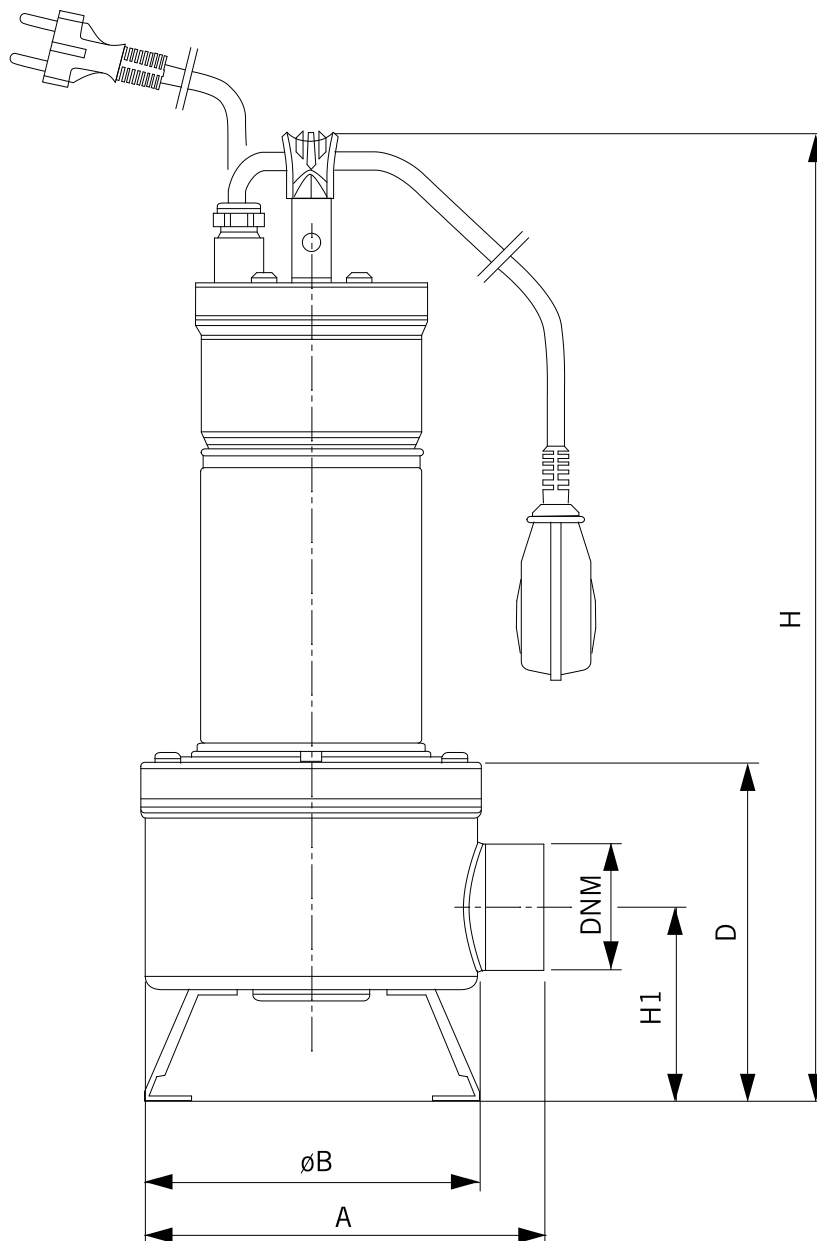

Dimensiuni in mm

Racorduri pompa:

|    |     |      |  |  |  |  |  |  |  |           |
|----|-----|------|--|--|--|--|--|--|--|-----------|
| 1  | A   | 203  |  |  |  |  |  |  |  |           |
| 2  | B   | 170  |  |  |  |  |  |  |  |           |
| 3  | D   | 172  |  |  |  |  |  |  |  | Aspiratie |
| 4  | DNM | 2" F |  |  |  |  |  |  |  |           |
| 5  | H   | 475  |  |  |  |  |  |  |  | Refulare  |
| 6  | H1  | 98   |  |  |  |  |  |  |  | 2" GAS    |
| 7  |     |      |  |  |  |  |  |  |  | --        |
| 8  |     |      |  |  |  |  |  |  |  |           |
| 9  |     |      |  |  |  |  |  |  |  |           |
| 10 |     |      |  |  |  |  |  |  |  |           |
| 11 |     |      |  |  |  |  |  |  |  |           |

MAIN\_PROJECT\_TITLE

BUSINESS\_PROCESS\_ID

OWNER\_

ISSUE\_DATE

05/07/2026